


NOTICE

Addendum 1 (February 19, 2021)

The following questions were posed to NEKAAA regarding #21-03-5339-CAM. Responses are provided in **red**.

1. Can NEKAAA please provide an overhead outdoor picture of the facility and approximate location of where to mount the access point and place the server, with approximate distances from AP to server?

A visual of the site with locations marked is provided below.

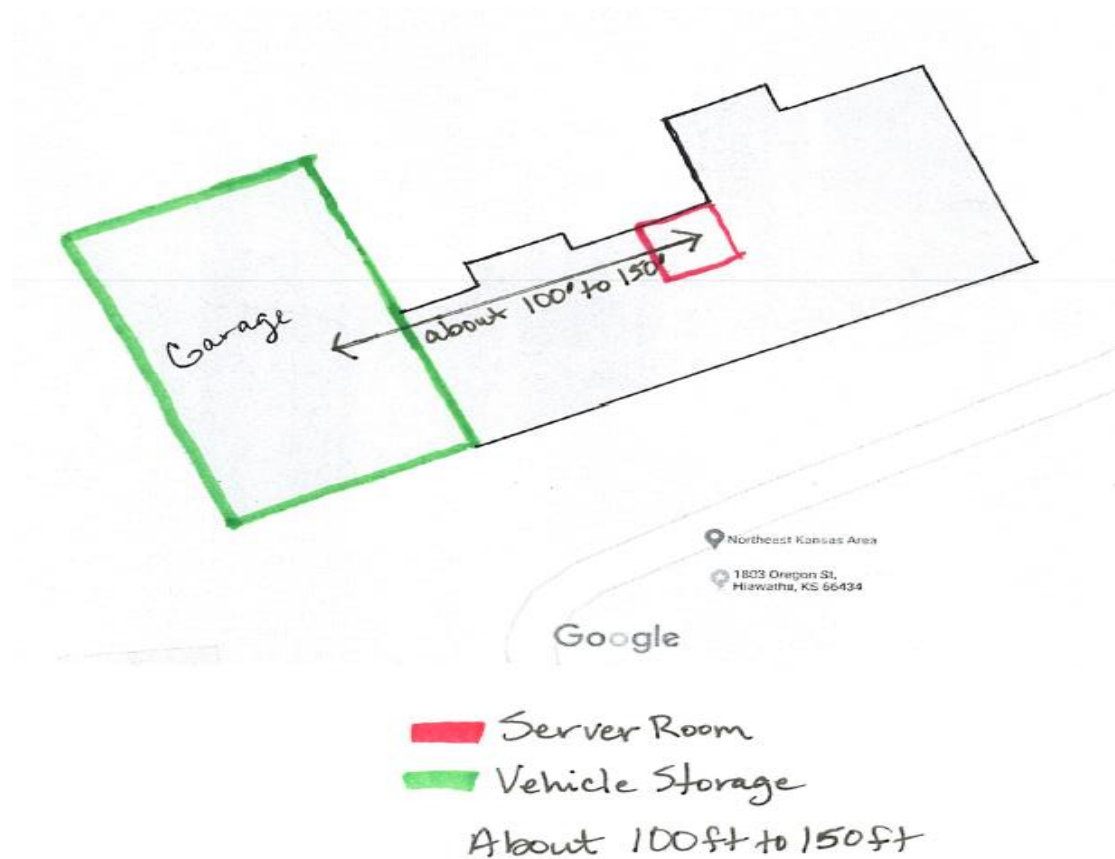

2. Our office is without power and many of our employees are without power at their homes as well. Would NEKAA please consider extending the due date for this bid to allow us to properly prepare our response?

We will extend the deadline of this posting to 5:00 p.m. on March 12, 2021.

3. In regards to the winter storm, there are several road closures due to the roads being iced over and driving on roads is highly discouraged. Would NEKAA allow for electronic submission of proposals via email?

We will not except bids via email. We are hoping that the extension of deadline will allow for submittal of bids in person or via parcel.